
Submittal

BC-SSL-1.0 11-01-15

## SSL


Belt Drive Bottom Return Blower Coil

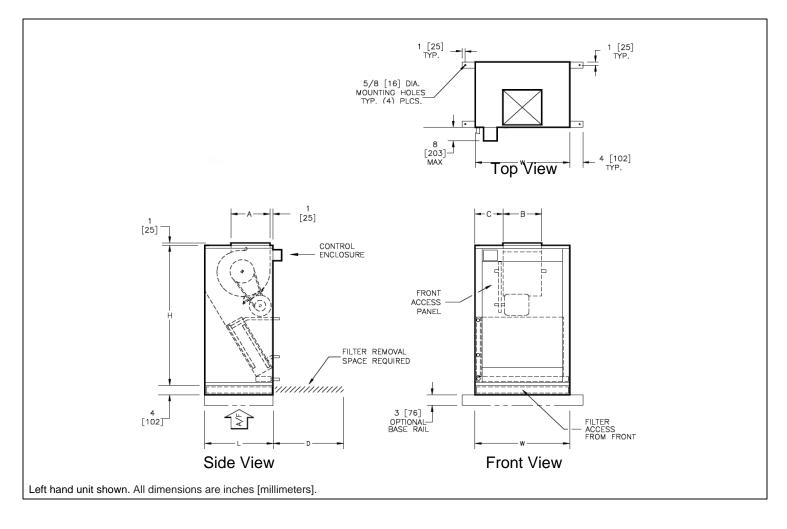

Unit Size	Filter Size	Quantity	н	w	L	А	В	С	D
08	16x20x2 [406x508x51]	1	46 [1168]	26 [660]	19 [483]	6 ½ [165]	6 7/8 [175]	9 9/16 [243]	16 [406]
12	20x20x2 [508x508x51]	1	46 [1168]	26 [660]	21 [533]	7 ½ [190]	8 ¼ [210]	8 7/8 [225]	20 [508]
16	24x24x2 [610x610x51]	1	54 [1372]	29 [737]	25 [635]	7 ½ [190]	10 ¼ [260]	9 3/8 [238]	24 [610]
20	24x24x2 [610x610x51]	1	54 [1372]	29 [737]	28 [711]	11 3/8 [289]	13 ¼ [337]	7 7/8 [200]	24 [610]
25	24x24x2 [610x610x51]	1 each	60 [1524]	39 [991]	28 [711]	13 1/2 [343]	12 7/8 [327]	13 1/16 [332]	24 [610]
30	12x24x2 [305x610x51]	1 each	60 [1524]	39 [991]	28 [711]	15 1/4 [387]	15 [381]	12 [305]	24 [610]


All rights reserved. No part of this work may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying and recording, or by any information storage retrieval system without permission in writing from Air Distribution Technologies Inc.

## Submittal

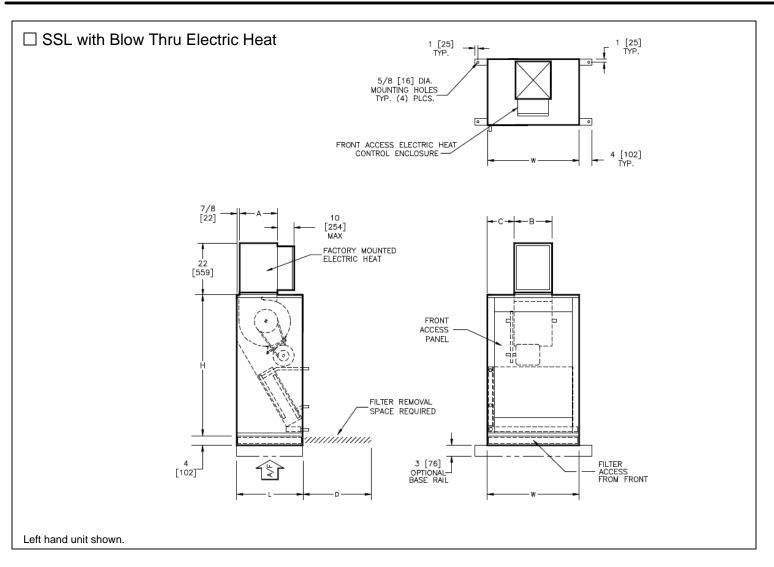

Unit Size	Filter Size	Quantity	н	W	L	А	В	С	D
08	16x20x2 [406x508x51]	1	46 [1168]	26 [660]	19 [483]	8 7/8 [226]	11 7/8 [302]	7 1/16 [180]	16 [406]
12	20x20x2 1 [508x508x51]		46 [1168]	26 [660]	21 [533]	8 7/8 [226]	11 7/8 [302]	7 1/16 [180]	20 [508]
16	24x24x2 [610x610x51]	1	54 [1372]	29 [737]	25 [635]	10 7/8 [277]	12 [305]	8 ½ [216]	24 [610]
20	24x24x2 [610x610x51]	1	54 [1372]	29 [737]	28 [711]	13 7/8 [353]	14 [356]	7 ½ [190]	24 [610]
25	24x24x2 [610x610x51]	1 each	60 [1524]	39 [991]	28 [711]	13 7/8 [353]	16 5/8 [422]	11 1/16 [281]	24 [610]
30	12x24x2 [305x610x51]	1 each	60 [1524]	39 [991]	28 [711]	15 5/8 [397]	16 5/8 [422]	11 1/16 [281]	24 [610]

## □ Return Plenum

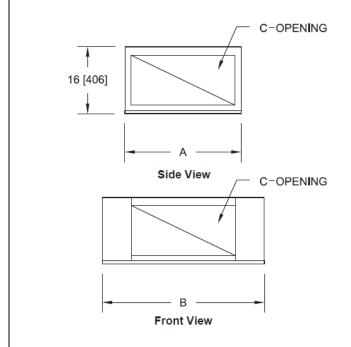


Unit Size	А	В	C-Opening
08	19	26	9x16
	[483]	[660]	[229x406]
12	21	26	9x18
	[533]	[660]	[229x457]
16	25	29	9x22
	[635]	[737]	[229x559]
20	28	29	12x22
	[711]	[737]	[305x559]
25	28	39	12x25
	[711]	[991]	[305x635]
30	28	39	12x25
	[711]	[991]	[305x635]


#### NOTES:

1. Bottom and back panels are fixed.

2. Both side panels are removable and can be used to cover the front opening.

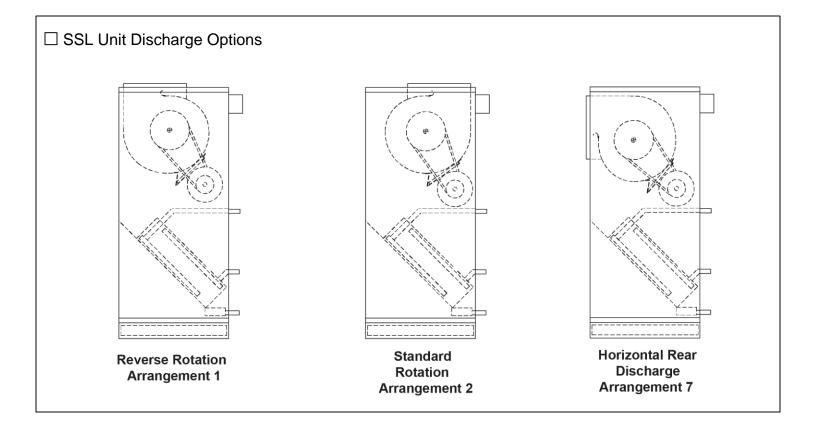

## **Submittal**

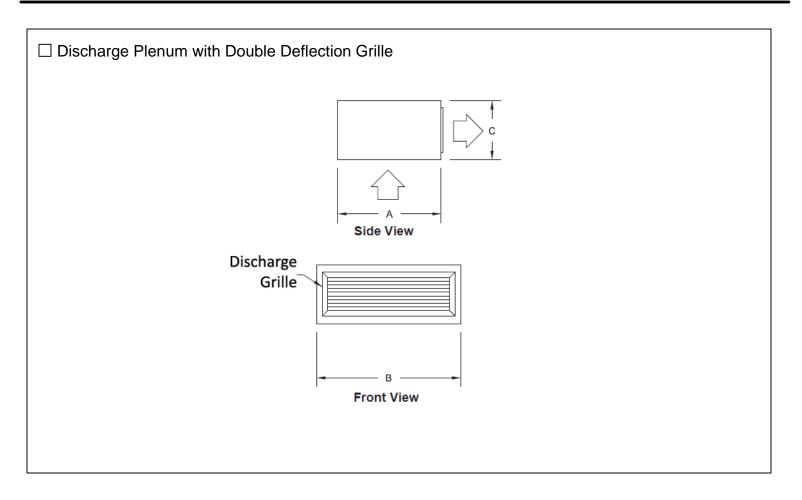


Unit Size	A	А В		Supply Grille
08	19	26	12	18x8
	[483]	[660]	[305]	[457x203]
12	21	26	12	22x8
	[533]	[660]	[305]	[559x203]
16	25	29	14	24x10
	[635]	[737]	[356]	[610x254]
20	28	29	16	24x12
	[711]	[737]	[406]	[610x305]
25	28	39	16	30x12
	[711]	[991]	[406]	[762x305]
30	28	39	16	36x12
	[711]	[991]	[406]	[914x305]

### NOTES:

- 1. Discharge plenum shipped attached to unit.
- 2. Discharge plenum includes double deflection discharge grille mounted on front as shown.
- 3. Discharge plenum may not be combined with blow through electric heat.

## Submittal

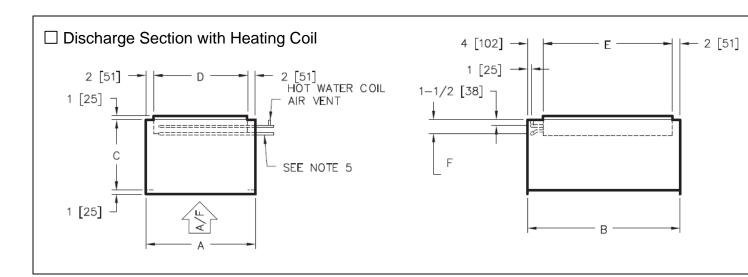

				D			F	=		Weight
Unit Size	A	В	С		E	Hot V	Vater	Ste	Lbs	
						1 Row	2 Row	1 Row	2 Row	[kg]
08	19	26	12	15	20	2 ¾	2 ¾	2 ¾	2 ¾	35
	[483]	[660]	[305]	[381]	[508]	[70]	[70]	[70]	[70]	[16]
12	21	26	12	17	20	2 ¾	2 ¾	2 ¾	2 ¾	37
	[533]	[660]	[305]	[432]	[508]	[70]	[70]	[70]	[70]	[17]
16	25	29	14	21	23	2 ¾	3	2 ¾	3 ¼	49
	[635]	[737]	[356]	[533]	[584]	[70]	[76]	[70]	[83]	[22]
20	28	29	14	24	23	2 ¾	3	3 ¼	3 ¼	53
	[711]	[737]	[356]	[610]	[584]	[70]	[76]	[83]	[83]	[24]
25	28	39	18	24	33	2 ¾	3	3 ¼	3 ¾	76
	[711]	[991]	[457]	[610]	[838]	[70]	[76]	[83]	[95]	[35]
30	28	39	18	24	33	3	3 ¼	3 ¾	3 ¾	80
	[711]	[991]	[457]	[610]	[838]	[76]	[83]	[95]	[95]	[36]

## **Coil Connection Sizes**

	Hot V	Vater	Steam							
Unit Size	1 Row	2 Row	1 F	Row	2 Row					
	TROW	2 1.00	Supply	Condensate	Supply	Condensate				
08	5/8	5/8	1 1/8	7/8	1 1/8	7/8				
	[16]	[16]	[29]	[22]	[29]	[22]				
12	5/8	5/8	1 1/8	7/8	1 1/8	7/8				
	[16]	[16]	[29]	[22]	[29]	[22]				
16	5/8	5/8	1 1/8	7/8	1 3/8	1 1/8				
	[16]	[16]	[29]	[22]	[35]	[29]				
20	5/8	5/8	1 3/8	1 1/8	1 3/8	1 1/8				
	[16]	[16]	[35]	[29]	[35]	[29]				
25	5/8	7/8	1 3/8	1 1/8	1 5/8	1 1/8				
	[16]	[22]	[35]	[29]	[41]	[29]				
30	7/8	7/8	1 5/8	1 1/8	1 5/8	1 1/8				
	[22]	[22]	[41]	[29]	[41]	[29]				

## NOTES:

- 1. This section required with 6 row cooling in conjunction with hot water and all steam heating.
- 2. Weight with 2 row dry coil.
- 3. Coil connection dimension + 1/2" [13mm].
- 4. Hot Water Coils: Supply, bottom; Return, top.
- 5. Steam Coils: Supply, top; Condensate, bottom.
- 6. Discharge section may not be combined with blow thru electric heat.

All dimensions are inches [millimeters].

## Coil

SSL is available with hot water, chilled water, direct expansion (DX), and standard steam coils for specific application. Coils are AHRI certified and labeled.

						COIL T	YPE					
UNIT		WA	TER			STE	EAM			REFRIG	BERANT	
SIZE		ROW 2 ROW	4 ROW	6 ROW	1 R	WO	2 ROW		4 R	WO	6 ROW	
	TROW		4 KOW	UKOW	STM.	COND.	STM.	COND.	LIQ.	SUCT.	LIQ.	SUCT.
08	5/8"	5/8"	7/8"	7/8"	1 1/8"	7/8"	1 1/8"	7/8"	5/8"	5/8"	5/8"	5/8"
00	[16]	[16]	[22]	[22]	[29]	[22]	[29]	[22]	[16]	[16]	[16]	[16]
12	5/8"	5/8"	7/8"	7/8"	1 1/8"	7/8"	1 1/8"	7/8"	5/8"	7/8"	5/8"	7/8"
12	[16]	[16]	[22]	[22]	[29]	[22]	[29]	[22]	[16]	[22]	[16]	[22]
16	5/8"	5/8"	7/8"	1 1/8"	1 1/8"	7/8"	1 3/8"	1 1/8"	5/8"	7/8"	5/8"	7/8"
10	[16]	[16]	[22]	[29]	[29]	[22]	[35]	[29]	[16]	[22]	[16]	[22]
20	5/8"	5/8"	7/8"	1 1/8"	1 3/8"	1 1/8"	1 3/8"	1 1/8"	5/8"	7/8"	5/8"	7/8"
20	[16]	[16]	[22]	[29]	[35]	[29]	[35]	[29]	[16]	[22]	[16]	[22]
25	5/8"	7/8"	1 1/8"	1 3/8"	1 3/8"	1 1/8"	1 5/8"	1 1/8"	5/8"	7/8"	5/8"	1 1/8"
25	[16]	[22]	[29]	[35]	[35]	[29]	[41]	[29]	[16]	[22]	[16]	[29]
30	7/8"	7/8"	1 1/8"	1 3/8"	1 5/8"	1 1/8"	1 5/8"	1 1/8"	5/8"	1 1/8"	5/8"	1 1/8"
- 30	[22]	[22]	[29]	[35]	[41]	[29]	[41]	[29]	[16]	[29]	[16]	[29]

## Nominal Coil Connection Sizes

All dimensions are inches [millimeters].

#### NOTES:

1.Water coils are based on Standard GPM Circuiting. Consult Titus for applications requiring special circuiting.

2.Refrigerant coil connection sizes for single circuit coils and may vary with application. Contact Titus for double circuit coils.

3. All dimensional data is outside diameter (O.D.),.

## **Electric Heat**

			ELECTRIC HEAT KW LIMITS											
		LTAGE						Unit	Size					
	AND PH	HASE	0	8	1	2	1	6	2	20	2	5	3	30
			Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
	115	kW	3	5	3	5	3	5	4	5				
e	115	AMPs	26.1	43.5	26.1	43.5	26.1	43.5	34.8	43.5				
Phase	208	kW	3	9	3	9	3	9	4	9	6	9	6	9
	208	AMPs	14.4	43.3	14.4	43.3	14.4	43.3	19.2	43.3	28.8	43.3	28.8	43.3
<u>a</u> le	230	kW	3	11	3	11	3	11	4	11	6	11	6	11
Single	230	AMPs	13.0	47.8	13.0	47.8	13.0	47.8	17.4	47.8	26.1	47.8	26.1	47.8
S	277	kW	3	13	3	13	3	13	4	13	6	13	6	13
	211	AMPs	10.8	46.9	10.8	46.9	10.8	46.9	14.4	46.9	21.7	46.9	21.7	46.9
	208	kW	3	13	3	16	3	16	4	16	4	16	4	16
e	200	AMPs	8.3	36.1	8.3	44.4	8.3	44.4	11.1	44.4	11.1	44.4	11.1	44.4
Phase	230	kW	3	13	3	18	3	18	4	18	4	18	4	18
	230	AMPs	7.5	32.6	7.5	45.2	7.5	45.2	10.0	45.2	10.0	45.2	10.0	45.2
ee	460	kW	3	13	3	20	3	20	4	26	4	26	4	26
Three		AMPs	3.8	16.3	3.8	25.1	3.8	25.1	5.0	32.6	5.0	32.6	5.0	32.6
	575	kW	3	13	3	20	3	20	4	26	4	26	4	26
	5/5	AMPs	3.0	13.1	3.0	20.1	3.0	20.1	4.0	26.1	4.0	26.1	4.0	26.1

#### NOTES:

1. Electric heat sections may be shipped separate for field installation to unit..

2.Standard heater kW limits are maximum per unit size and voltage.

3.Heater should be sized for a maximum leaving air temperature of 104° F.

## **Submittal**

# SUPERIOR REX

## Unit Weight Data

COMP	ONENT	UNIT SIZE									
CONF	ONENT	08	12	16	20	25	30				
BASI	BASIC UNIT		131 [60]	160 [73]	167 [76]	231 [105]	236 [107]				
DAMPER	SECTION	42 [19]	53 [24]	59 [27]	73 [33]	91 [41]	91 [41]				
BLOW THRU EL	ECTRIC HEATER	42 [19]	42 [19]	42 [19]	50 [23]	55 [25]	55 [25]				
DISCHARGE	COIL SECTION	35 [16]	37 [17]	49 [22]	53 [24]	76 [35]	80 [36]				
SUPPLY	PLENUM	22 [10]	26 [12]	35 [16]	38 [17]	76 [35]	76 [35]				
RETURN P	LENUM (ACB)	29 [13]	30 [14]	33 [15]	35 [16]	44 [20]	44 [20]				
	1 ROW - DRY	12 [5]	14 [6]	17 [8]	21 [10]	23 [10]	27 [12]				
	1 ROW - WET	14 [6]	17 [8]	21 [10]	26 [12]	28 [13]	34 [15]				
	2 ROW - DRY	17 [8]	21 [10]	26 [12]	32 [15]	37 [17]	43 [20]				
COIL ROWS	2 ROW - WET	21 [10]	27 [12]	33 [15]	42 [19]	48 [22]	56 [25]				
	4 ROW - DRY	29 [13]	36 [16]	45 [20]	57 [26]	65 [30]	76 [35]				
	4 ROW - WET	37 [17]	47 [21]	58 [26]	75 [34]	86 [39]	101 [46]				
	6 ROW - DRY	40 [18]	51 [23]	64 [29]	81 [37]	93 [42]	109 [50]				
	6 ROW - WET	52 [24]	66 [30]	84 [38]	109 [50]	124 [56]	146 [66]				

#### NOTES:

1. Unit weight data is shipping weight in pounds [kilograms].

2.Discharge section includes a 2 row coil.

## Submittal

## STANDARD FEATURES

### Construction

- Galvanized steel cabinet construction, minimum 18 gauge
- 1" thick 1.6 lb/ft<sub>3</sub> scrim reinforced foil faced insulation, glued, taped and pinned in place
- 1" supply duct collars
- Gasketed, removable access panel sized for easy handling
- Galvanized steel drain pan with 1 1/8" ODM copper pipe outlet
- Left and right hand arrangement

## Fan Assembly

- Forward curved (double width, double inlet) fans
- Statically and dynamically balanced
- Solid steel shafting
- Ball bearings with a minimum design average life (L50) of 100,000 hours

## Fan Motor and Drive

- NEMA design ODP motors
- 1750 RPM single speed, 60 Hertz
- Single phase motors with inherent thermal protection
- Three phase motors
- Rigid mount adjustable motor base
- Standard cross section "V-belt" drive with 1.2 service factor
- Adjustable pitch motor pulley and fixed pitch blower pulley

## Coils

- ARI 410 certified and labeled
- 1/2" O.D. seamless copper tubes
- Collared and corrugated aluminum fins
- Manual air vent plug on all water coils
- 300 PSIG working pressure at 200°F
- Steam coils rated at 15 PSIG maximum
- Copper ODM sweat connections
- 0.016" tube wall on water and evaporator coils
- 0.025" tube wall on steam coils
- High efficiency aluminum fin surface for optimizing heat transfer, pressure drop and carryover

### **Filters and Filter Rack**

- Top access flat filter rack (SSL only)
- Standard size 2" nominal throwaway filters

### Electrical

- Fan motor wired and terminated to J-box
- All units ETL listed in compliance with UL/ANSI Standard 1995

## **OPTIONAL FEATURES**

### Construction

- Stainless steel drain pan with 1" MPT galvanized pipe outlet
- External rubber-in-shear or spring type vibration isolators, floor mount
- Fan discharge arrangements
- Discharge plenum w/ dbl. deflection discharge grille
- Access panel with lift and turn fasteners
- Double wall access panel w/lift and turn fasteners
- Return plenum with removable panels (ACB only)
- Base rails with rigging slots factory assembled and installed

### Fan Motor and Drive

- TEFC motors
- High efficiency motors

### Coils

- 4 and 6 row chilled water or R22 DX coils
- 1 and 2 row hot water coils
- 1 and 2 row hot water or standard steam coils in discharge coil section only
- Hot water coil in preheat or reheat position
- Stainless steel coil casings
- 0.025" tube wall on water and evaporator coils
- Auto air vents on water coils

### **Filters and Filter Rack**

- 2" pleated filter
- Spare throwaway or pleated filters

### Electrical

- Motor wiring in conduit
- Motor starter (contactor with overload for three phase; contactor for single phase), factory installed (mounted and wired)
- Door interlocking disconnect switch (non-fused) (with main fusing)
- Hand off auto switch (HOA)
- Main fusing

### **Electric Heat Section**

 Factory mounted electric heater with single point power connection, ETL listed as an assembly (see page 9)